


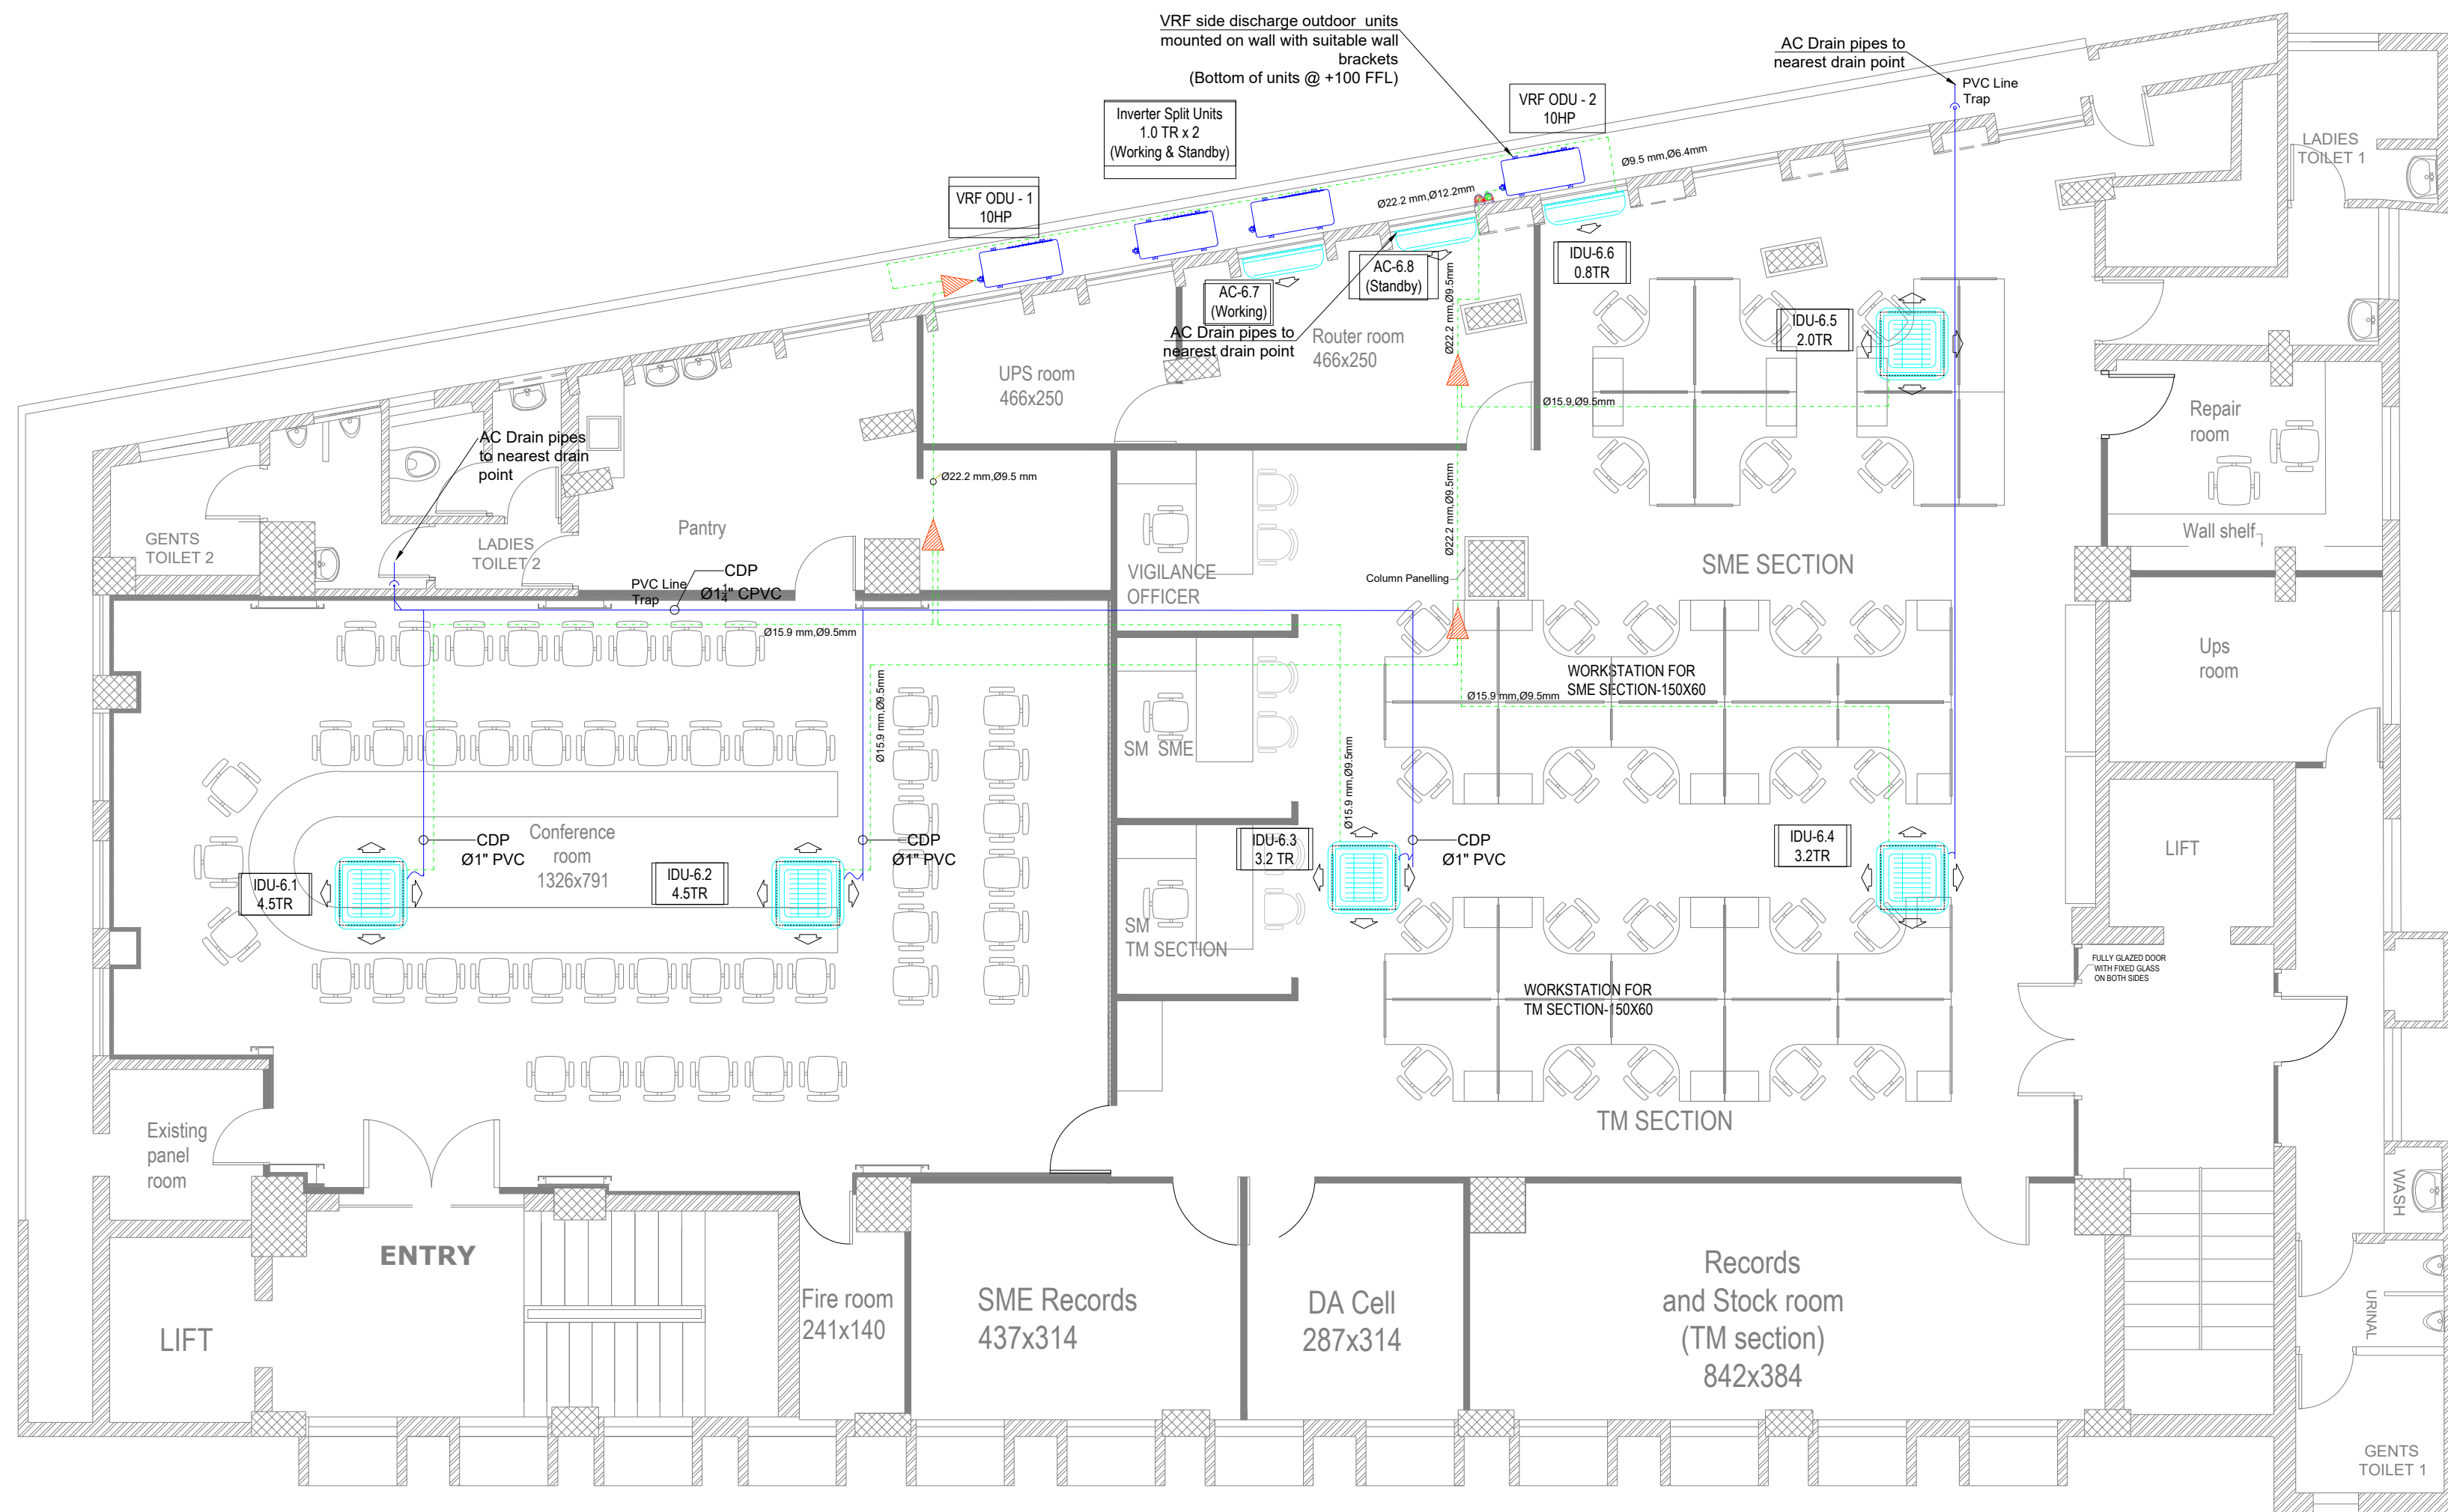

KEY PLAN :

NOTES :

- All dimensions are in centimeters unless specified.
- All drain pipes above false ceiling and concealed in wall shall be insulated with 9 mm thick closed cell XLPE insulation
- A minimum slope of 1:100 shall be maintained for horizontal drain pipe and suitable in-line trap to be provided.
- All structural penetrations shall be cleaned & sealed with suitable sealants
- Contractor has to check and confirm the air-conditioned spaces are well isolated and no possible contaminations / in-filtrations

LEGENDS :

SYMBOL	DESCRIPTION
	REFRIGERANT PIPE (L&S)
	AC CONDENSATION DRAIN PIPE
	REFNET JOINT
	230V, 1Ø SUPPLY FOR AC IDU
	230V, 1Ø SUPPLY WITH SWITCH FOR SPLIT AC
	415V, 3Ø SUPPLY FOR AC ODU

REVISION HISTORY:

REV	DATE	DESCRIPTION	BY	AP
03	10-02-2023	Updated interior layout		
02	10-01-2023	For Approval		
01	06-01-2023	For Approval		
00	30-12-2022	For Approval		

ISSUED FOR TENDER

PROJECT :

CANARA BANK, CIRCLE OFFICE,
TRIVANDRUM

CLIENT :



ARCHITECT:

Ar.DEVI ANILKUMAR

HVAC CONSULTANT:



DRAWING TITLE:

AC LAYOUT - 6TH FLOOR

ORIGINAL SCALE:	DRAWN: JG	CHECKED: AF	AUTHORISED:	SIZE:
1:100	DATE: 10-02-2023	DATE:	DATE:	A3
JOB NO: 164	DRAWING NO: CBC6-MEP-AC-601			REV: 03
PAGE NO:				